



CONSENT NUMBER: N2670

WATER INDUSTRY ACT 1991

WATER ACT 2003

ENVIRONMENTAL PROTECTION ACT 1990

ENVIRONMENT ACT 1995

THE POLLUTION PREVENTION AND CONTROL ACT 1999

CONSENT TO THE DISCHARGE OF TRADE EFFLUENT

WHEREAS THE UNIVERSITY OF NEWCASTLE UPON TYNE (the "Trader") whose registered office is at 6 Kensington Terrace, Newcastle upon Tyne, NE1 7RU being the occupier of the trade premises at Newcastle University, Newcastle upon Tyne, NE1 7RU (the "Trade Premises") and by an application dated 4 May 2007 (the "Application") has applied to **NORTHUMBRIAN WATER LIMITED** (the "Company") for consent to discharge trade effluent from the Trade Premises into the Company's sewers

AND WHEREAS the Environment Agency ("EA"), or such other body carrying out its functions, may issue authorisation ("EA Authorisation") with regard to a prescribed process designated for central control under Part I of the Environmental Protection Act 1990 ("EPA 1990") or may issue a permit ("IPPC Permit") with regard to an industrial site under The Pollution Prevention and Control Regulations 2000 (SI 2000 No: 1973) thereby setting out particular conditions with regard to part, or all, of the trade effluent discharged from the Trade Premises

NOW THEREFORE in the exercise of the powers conferred upon it by the Water Industry Act 1991 and any Act amending or replacing the same the Company **HEREBY CONSENTS** to the discharge of the trade effluent by the Trader into its sewers **SUBJECT TO THE FOLLOWING CONDITIONS.**

1. **EA AUTHORISATION**

This Consent is always subject to the provisions of any EA Authorisation or IPPC Permit in force from time to time in respect of prescribed processes (as defined in the EPA 1990) carried out at the Trade Premises. In the event of any conflict between the provisions of this Consent and the provisions of the said EA Authorisation(s) or IPPC Permit the more stringent requirement shall prevail.



2. NATURE AND COMPOSITION

The trade effluent discharged under this Consent shall be waste water containing those constituents specified in Clause 8 of the Application insofar as the discharge of those constituents does not breach Clauses 7 to 11 of this Consent.

3. POINT OF DISCHARGE

The sewers into which the trade effluent may be discharged are the company's public foul sewers within the area highlighted on the Application as attached hereto. No change shall be made in the location of any discharge point without the prior written consent of the Company.

4. CHANGE IN CIRCUMSTANCE

The Trader shall give to the Company two months' notice in writing of any changes or proposed changes in manufacturing process, raw materials, pre-treatment of the trade effluent or any other circumstances likely to alter the nature or composition of the trade effluent and of any circumstances resulting or likely to result in a cessation of the discharge. Any such changes will be a change of circumstances for the purposes of Section 125 (2) of the Act.

One of the circumstances that constitutes a significant change in the nature of the trade effluent will be a change in the ratio of the Total Chemical Oxygen Demand to the Total 5 day Biochemical Oxygen Demand (ATU modification) of the trade effluent. In such a circumstance the Company will be entitled to issue a variation of the conditions of this Consent in accordance with Sections 124 and 125 of the Act.

5. CHANGE OF NAME *etc*

5.1 The Trader shall notify the Company in writing within twenty one (21) days of any change to the name or address of the owner or occupier of the Trade Premises.

5.2 Where there is a change of occupier, this Consent is automatically discharged: the new occupier must serve an application upon the Company for consent to discharge.

6. CONNECTIONS

No connections shall be made to the Company's sewer system without the prior written approval of the Company and all such connections shall be constructed and maintained to the satisfaction of the Company at the expense of the Trader.



7. MAXIMUM QUANTITY OF DISCHARGE

The maximum amount of the trade effluent discharged during any one period of 24 hours shall not exceed two (2) cubic metres, except where no trade effluent is discharged by the Trader from the Trade Premises for a period of six months when Clause 16 of this Consent applies.

8. MAXIMUM RATE OF DISCHARGE

The maximum rate at which the trade effluent may be discharged shall not exceed one (1) litre per second.

9. TEMPERATURE

No trade effluent shall be discharged which has a temperature higher than 43 degrees Celsius.

10. pH VALUE

No trade effluent shall be discharged having a pH value of less than 6 or greater than 10.

11. MATTERS TO BE ELIMINATED PRIOR TO DISCHARGE TO SEWER

The following are strictly prohibited from entry to the Company's sewers and shall be eliminated from the trade effluent before it is discharged to the sewers of the Company:

11.1 Any special category effluent listed in Schedule 1 to The Trade Effluents (Prescribed Processes and Substances) Regulations 1989 (S.I.1156) or any other statutory instrument amending them (the "Regulations") insofar as they are in a concentration greater than the background concentration as defined in the Regulations (see Appendix): unless the discharge of prescribed substances is permitted by an EA Notice of Determination or IPPC Permit.

11.2 Any substance which is not special category effluent but which is within List I designated from time to time under provisions of EC Directive 76/464/EEC and in particular Articles 6 and 12 thereof, in so far as they are in a concentration greater than in water supplied to the Trade Premises for domestic uses (see Appendix): unless they are specifically authorised by an EA Authorisation or IPPC Permit or under section 11.6 below.

11.3 Any petroleum spirit or other solvent in mixture or in solution, at levels likely to cause a nuisance or produce flammable, harmful, or toxic vapours in the sewer system; or be dangerous to or cause injury to any person working in the sewer or at the sewage treatment works unless they are specifically authorised under section 11.6 below.



NORTHUMBRIAN WATER LIMITED

- 11.4 Any other constituent of the trade effluent specified in Clause 8 of the Application as that which is likely to injure or obstruct sewers, or to make the treatment or disposal of the sewage from those sewers specially difficult or expensive, unless they are specifically authorised under section 11.6 below.
- 11.5 Any living genetically modified organisms.
- 11.6 Any constituents excepting the following not exceeding the concentrations stated:-

Constituents	Limit (milligrams per litre)	When expressed as
Total Chemical Oxygen Demand (Dichromate Value)	1000	O ₂
Suspended solids dried at 105°C	200	-

The analytical method used to determine the concentration of the constituent in any sample shall be that method used from time to time by Northumbrian Water Limited's analyst or agent. The method will be a Standing Committee of Analysts or equivalent method, where "equivalent" relates to the same accuracy and precision.

12. PAYMENT

- 12.1 The Trader shall pay to the Company such charges for the reception, conveyance, treatment and disposal of the trade effluent in accordance with the Company's Charges Scheme in force from time to time and made in pursuance of section 143 Water Industry Act 1991 (or any subsequent amendment) and such charges shall be due and payable on demand and will include any additional expenses incurred or likely to be incurred by the Company in connection with the reception, conveyance, treatment and disposal of the Trader's trade effluent.
- 12.2 Where the Trader is in arrears of four weeks or more in payment of the charges specified above, this Consent may be terminated by the Company straightaway.

13. ENTRY AND SAMPLES

- 13.1 An inspection chamber or manhole shall be provided and maintained by the Trader in the position indicated on the plan attached hereto and shall be so constructed and maintained as to enable a person authorised by the Company readily to obtain samples at any reasonable time of the trade effluent so discharged.



13.2 The Trader shall permit duly authorised representatives of the Company to inspect examine and test at all reasonable times any works and apparatus installed in connection with the trade effluent and to take samples of the trade effluent.

13.3 The Trader shall ensure that no matter other than trade effluent shall pass through the inspection chamber or manhole.

14. MEASUREMENT AND DETERMINATION OF DISCHARGE

14.1 The Trader shall keep such records as are required by any competent authority and its agents in pursuance of provisions concerned with genetically modified materials contained within Regulations emanating from the Health and Safety at Work etc Act 1974, the Environmental Protection Act 1990 and associated legislation. These records shall demonstrate that the trade effluent shall not contain any live genetically modified material

14.2 The Trader shall make those records available for inspection by the Company or its agents upon reasonable notification or its requirement to inspect.

14.3 If the measuring and/or recording apparatus ceases to function correctly then the Company shall have the right to make estimates of the volume and composition of the trade effluent until such time as the apparatus is again operating to the satisfaction of the Company.

14.4 The Company and the Trader may from time to time agree alternative methods of complying with the foregoing provisions.

15. BREACH OF CONDITIONS OF CONSENT

The Trader shall notify the Company immediately by the quickest practicable means (usually by telephone) of any discharge from the Trade Premises which contravenes any of the provisions of this Consent. The initial notification shall be followed up by a written report which shall be submitted by the Trader to the Company within 7 working days setting out the nature of the breach, the circumstances that resulted in the breach and the action taken by the Trader.

16. EXPIRY

16.1 Unless otherwise agreed in writing by the Company where no trade effluent is discharged by the Trader from the Trade Premises for a period of six months the maximum amount of the trade effluent discharged during any one period of 24 hours shall be zero, *ie* this Consent will automatically expire. For this six month period of non-discharge the Trader will be charged the minimum amount on the trade effluent scale as provided by the Company's Charges Scheme in force from time to time.



- 16.2 If the Trader later wishes to resume the discharge after such six month period of non-discharge, a new application for a Consent must be served on the Company.
- 16.3 This Consent may be terminated at any time by agreement between the parties subject to a minimum of four weeks notice on either side.
- 16.4 This Consent will expire automatically on the grounds set out at section 5.2 above.


17. REFERENCE PURSUANT WATER INDUSTRY ACT 1991 PART IV CHAPTER III

17.1 Where any notice of determination or other document is issued by the Environment Agency pursuant to section 132 Water Industry Act 1991 (the "Notice") in respect of any part of the trade effluent discharge from the Trade Premises the terms and conditions of the Notice will be given effect by this Consent.

18. INTERPRETATION

Words and expressions to which meanings are assigned by the Environment Act 1995, the Environmental Protection Act 1990, the Water Industry Act 1991, Water Resources Act 1991, Water Consolidation (Consequential Provisions) Act 1991 (or any legislation amending or affecting the same) shall have the same meaning assigned to them when used in this Consent.

Dated this 20 July 2007

SIGNED: 

TRADE EFFLUENT COMPLIANCE MANAGER
For and on behalf of Northumbrian Water Limited

NOTE: Your attention is drawn to Section 122 Water Industry Act 1991 which provides that any person aggrieved by any condition attached to this consent may appeal to The Water Services Regulation Authority.

ADDRESS TO WHICH ALL COMMUNICATIONS SHOULD BE SENT:

D W Allan
Northumbrian Water Limited
Leat House
Pattinson Road
District 15, Washington
Tyne and Wear, NE38 8LB



NORTHUMBRIAN WATER LIMITED

Telephone: 0191 419 6547

Fax: 0191 419 6767

Attachments 1 Appendix
2 Drainage Plan



APPENDIX

THE TRADE EFFLUENTS (PRESCRIBED PROCESSES AND SUBSTANCES) REGULATIONS 1989

(as at 31 August 1990)

Section 120 Water Industry Act 1991 and the above Regulations oblige Northumbrian Water Limited (unless it intends to refuse the application) to refer to the Environment Agency any application to discharge special category trade effluent which;

- a) contains any of the substances listed in Schedule 1 below in a concentration greater than the background concentration or,
- b) is derived from a process in Schedule 2 below if either chloroform or asbestos is present in a concentration greater than the background concentration.

In these circumstances consent for the discharge cannot be granted except to the extent that the Secretary of State consents and subject to any conditions he may specify.

PRESCRIBED SUBSTANCES - SCHEDULE 1

Mercury and its compounds	Dichlorvos
Cadmium and its compounds	1,2-Dichloroethane
gamma-Hexachlorocyclohexane	Trichlorobenzene
DDT	Atrazine
Pentachlorophenol and its compounds	Simazine
Hexachlorobenzene	Tributyltin compounds
Hexachlorobutadiene	Triphenyltin compounds
Aldrin	Trifluralin
Dieldrin	Fenitrothion
Endrin	Azinphos-methyl
Carbon Tetrachloride	Malathion
Polychlorinated Biphenyls	Endosulfan

PRESCRIBED PROCESSES - SCHEDULE 2

Any process for the production of chlorinated organic chemicals
Any process for the manufacture of paper pulp
Any process for the manufacture of asbestos cement
Any process for the manufacture of asbestos paper or board
Any industrial process involving the use in any 12 month period of more than 100Kg of the product resulting from the crushing of asbestos ore.

BACKGROUND CONCENTRATION

This is defined in the Regulations and in effect means the concentration of a substance present in the water supplied to, or abstracted for use, in the premises and which is present in rainfall onto the premises. If the trade process adds to that background concentration then the substance should be regarded as being present at a concentration greater than the background concentration.



CONSENT REGISTER NUMBER: N2670

DISCHARGE OF TRADE EFFLUENT - SUMMARY OF CONDITIONS

Name of Firm: THE UNIVERSITY OF NEWCASTLE UPON TYNE

Registered Number:

Registered Office: 6 Kensington Terrace, Newcastle upon Tyne, NE1 7RU

Situation of Premises: Newcastle University, Newcastle upon Tyne, NE1 7RU

Receiving Works: Howdon

Sewer Connection: the sewer into which the trade effluent may be discharged are those within the area highlighted on the Application

Waste Derived From: GMO's

Maximum Permitted Daily Volume of Discharge : two (2) cubic metres
 Maximum Permitted Rate of Discharge : one (1) litre per second
 Maximum Permitted Temperature of Discharge : 43 degrees Celsius
 Range of pH Permitted : 6 to 10

Limitations (other than standard conditions)

Constituents	Limit (milligrams per litre)	When expressed as
Total Chemical Oxygen Demand (Dichromate Value)	1000	O ₂
Suspended solids dried at 105°C	200	-

Date of Application: 4 May 2007
Date of Consent/Agreement: 20 July 2007

Body Account No.		PRN		Meter	
Site Ref:		PLR		Drainage Area	
Contact:			Telephone No.		

Our Ref: DWA/AB
Date: 20 July 2007

The Company Secretary
THE UNIVERSITY OF NEWCASTLE UPON TYNE
6 Kensington Terrace
Newcastle upon Tyne
NE1 7RU

Dear Sirs

CONSENT TO THE DISCHARGE OF TRADE EFFLUENT :
REGISTER NUMBER N2670 (THE "CONSENT")

I enclose the Consent to Discharge Trade Effluent from the premises situated at Newcastle University, Newcastle upon Tyne, NE1 7RU granted in respect of treated trade effluent from any processes involving genetically modified material.

If you have any queries regarding the Consent, please contact D W Allan on the above telephone number.


I take this opportunity to remind you that under powers granted by virtue of s124 Water Industry Act 1991 Northumbrian Water Limited may give a direction varying conditions which have been attached to the above Consent. These powers are available two years after the date of the enclosed document: or at an earlier time if both Trader and Northumbrian Water Limited agree in writing.

Your attention is drawn to the right of appeal which is noted below the signature on the Consent. An appeal against this Consent must normally be made to The Water Services Regulation Authority within two months of your receipt of this Notice. For your information his address is:-

The Water Services Regulation Authority
Office of Water Services
Centre City Tower
7 Hill Street
Birmingham
B5 4UA

Please acknowledge receipt of the enclosed legal document.


Yours faithfully



D W ALLAN
TRADE EFFLUENT COMPLIANCE MANAGER

Enc

N2670 Newcastle University

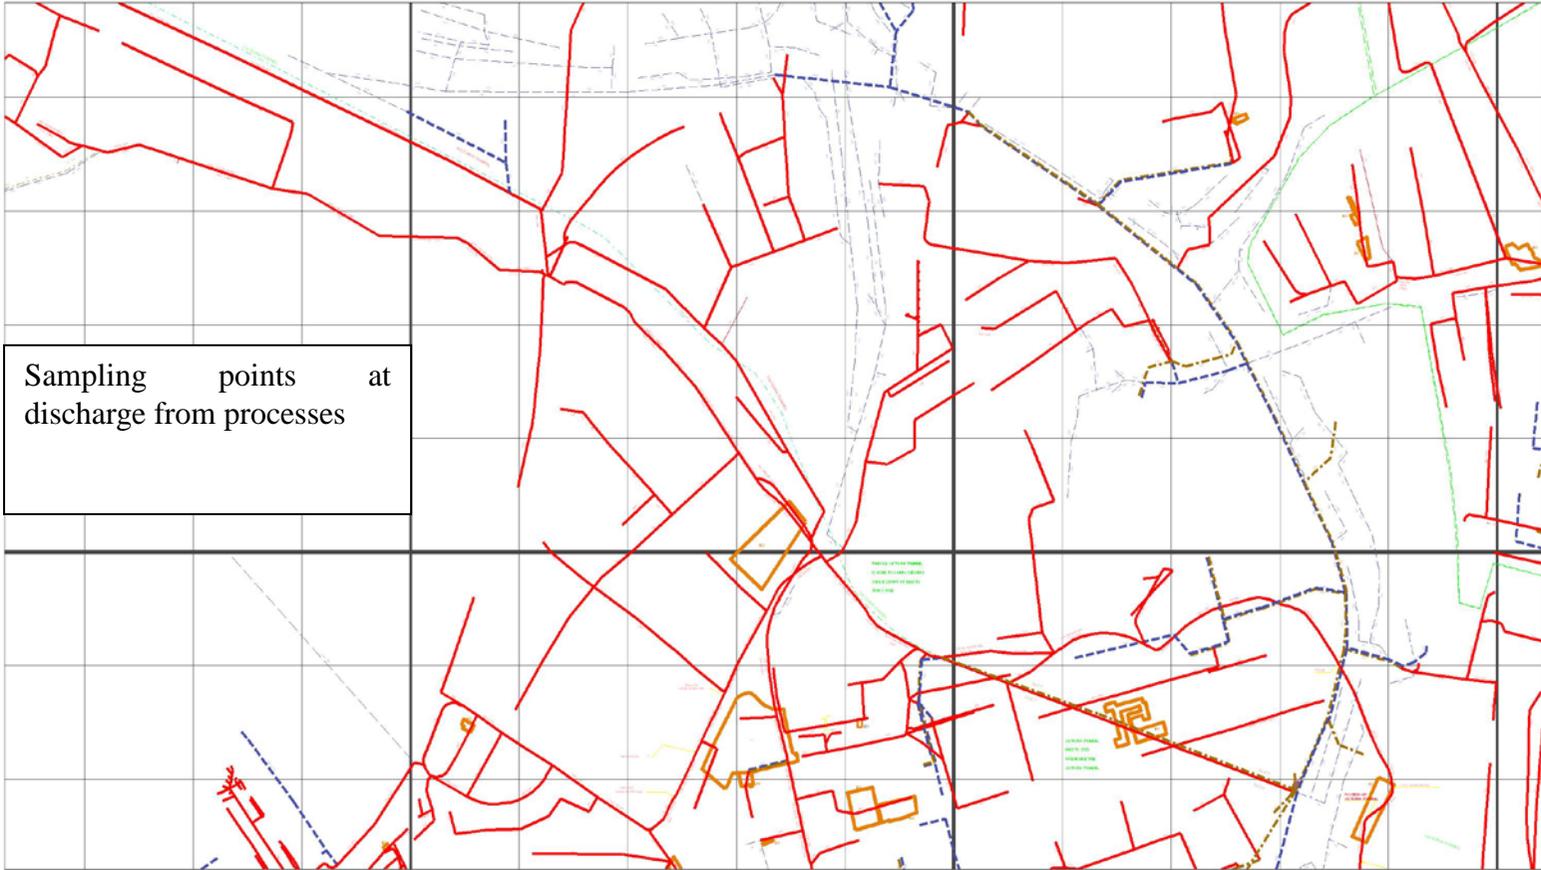

Sampling points at discharge from processes

Combined	Private	Abandoned	PRIVATE DRAIN
Foul	Highway Drain	Manhole	
Surface Water	Rising Main	Pumping Stn	
Watercourse	Backdrop	Adoption Agreement	

Author : ALLAD	Date : 18-06-2007	The material contained on this plan has been reproduced from an Ordnance Survey map with permission of the controller of HM S. Co. Crown Copyright Reserved. In view that no copyright is asserted for this plan, the copyright is regarded as appropriate and is asserted for guidance only. No Liability of any kind whatsoever is accepted by Northumbrian Water, its servants or agents for any omission. The actual position of any water feature or object shown on the plan must be established by taking trial holes in all cases. In the case of water mains Northumbrian Water must be given two weeks days notice of their intention to excavate trial holes. Private connections are not shown but their presence should be anticipated. WARNING: Where indicated on the plan there could be abandoned asbestos cement materials or shards of pipe. If excavating in the vicinity of these abandoned asbestos cement materials, the appropriate Health & Safety precautions should be taken. Northumbrian Water accepts no liability in respect of claims, costs, losses or other liabilities, which arise as the result of the presence of the pipes or any failure to take adequate precautions. Emergency Telephone Number: 0945 717 1100
Title :	Sheet : NZ2465	
Centre Point : 424834,565102	Scale : Not to scale	

